
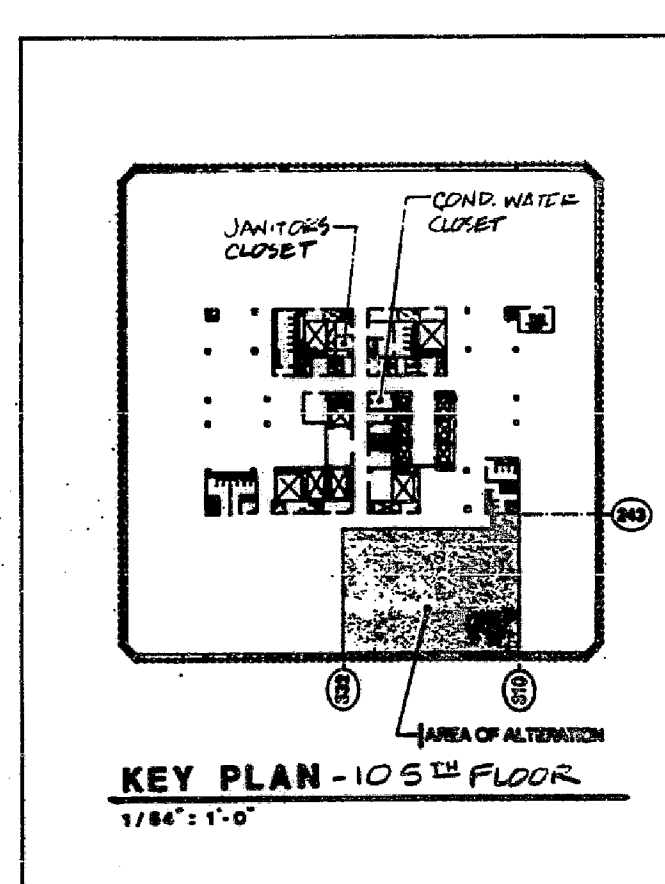
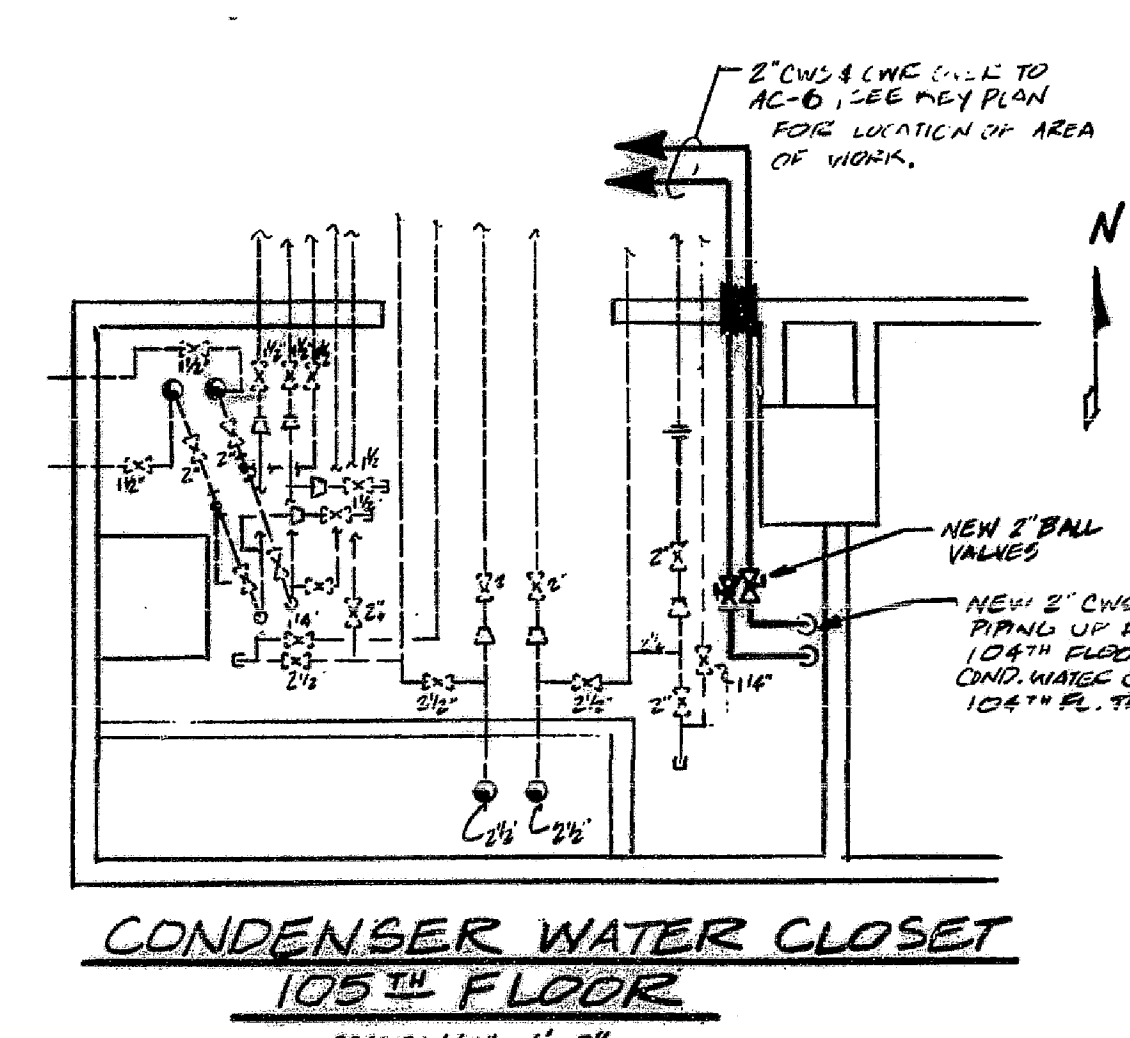
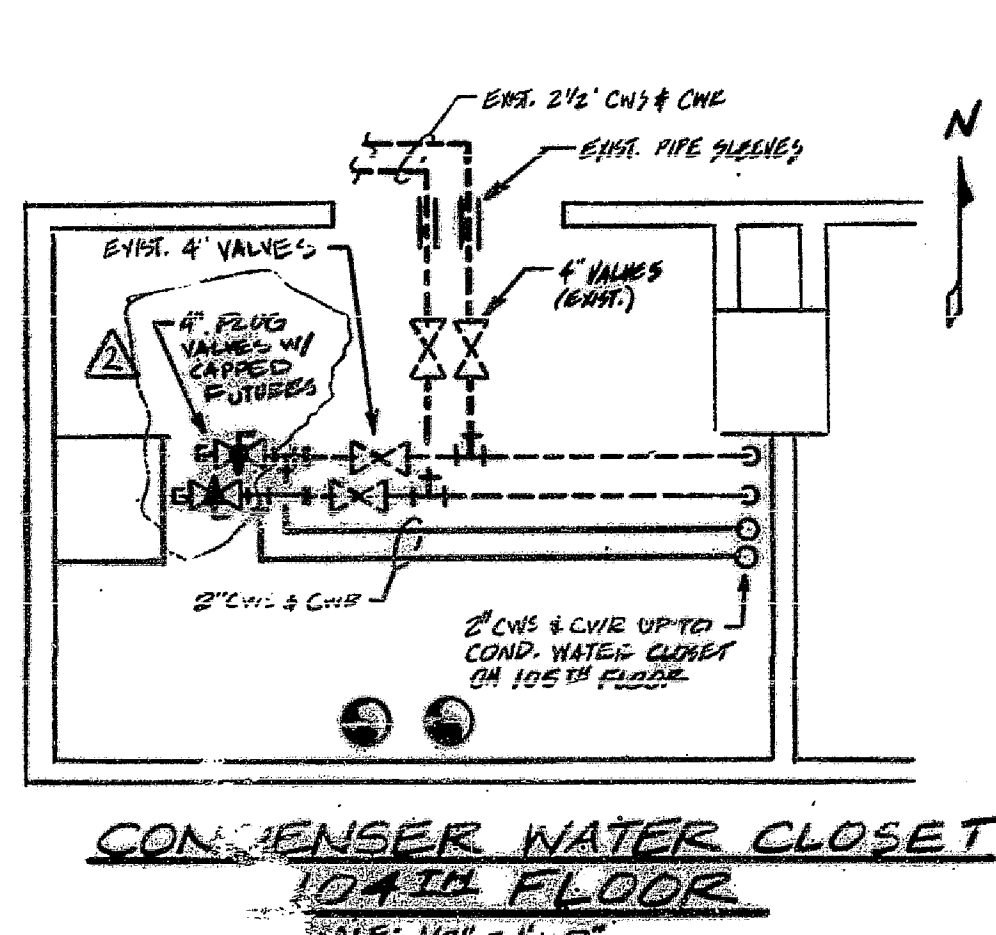


LEGEND

- NEW DUCTWORK SUPPLEMENTAL COOLING
- NEW BASE BUILDING DUCTWORK
- EXISTING DUCTWORK SUPPLEMENTAL COOLING
- EXISTING BASE BUILDING DUCTWORK
- NEW SUPPLY AIR DIFFUSER (4-WAY), BB DENOTES BASE BUILDING
- NEW SUPPLY AIR DIFFUSER (3-WAY), BB DENOTES BASE BUILDING
- EXISTING SUPPLY AIR DIFFUSER TO REMAIN
- EXISTING RETURN AIR GRILLE
- NEW AIR TRANSFER DUCT WITH FIRE DAMPER
- EXISTING AIR TRANSFER DUCT WITH FIRE DAMPER
- EXISTING FULL CAPACITY INDUCTION UNIT
- RELOCATED EXISTING 1/2 CAPACITY INDUCTION INCREASED TO FULL CAPACITY
- EXISTING 1/2 CAPACITY INDUCTION TO BE RELOCATED
- EXISTING 1/2 CAPACITY INDUCTION UNIT TO BE INCREASED TO FULL CAPACITY
- VP VOLUME DAMPER
- (375) CFM
- THERMOSTAT
- NEW CONDENSER WATER SUPPLY
- NEW CONDENSER WATER RETURN
- EXISTING CONDENSER WATER SUPPLY
- EXISTING CONDENSER WATER RETURN
- NEW CONDENSATE DRAIN PIPING
- EXISTING NEW CONDENSATE DRAIN PIPING
- SD SLUTTER DAMPER
- ROOM NUMBER
- BALL VALVE
- PLUG VALVE

NOTE: ALL NEW AND EXISTING FLUORESCENT LIGHTING FIXTURES ARE AIR HANDLING TYPE AND WILL BE USED FOR RETURN AIR PURPOSES.

EXIST. ADDITIONAL LINE ATTN TO REMAIN (TYP. FOR 2)

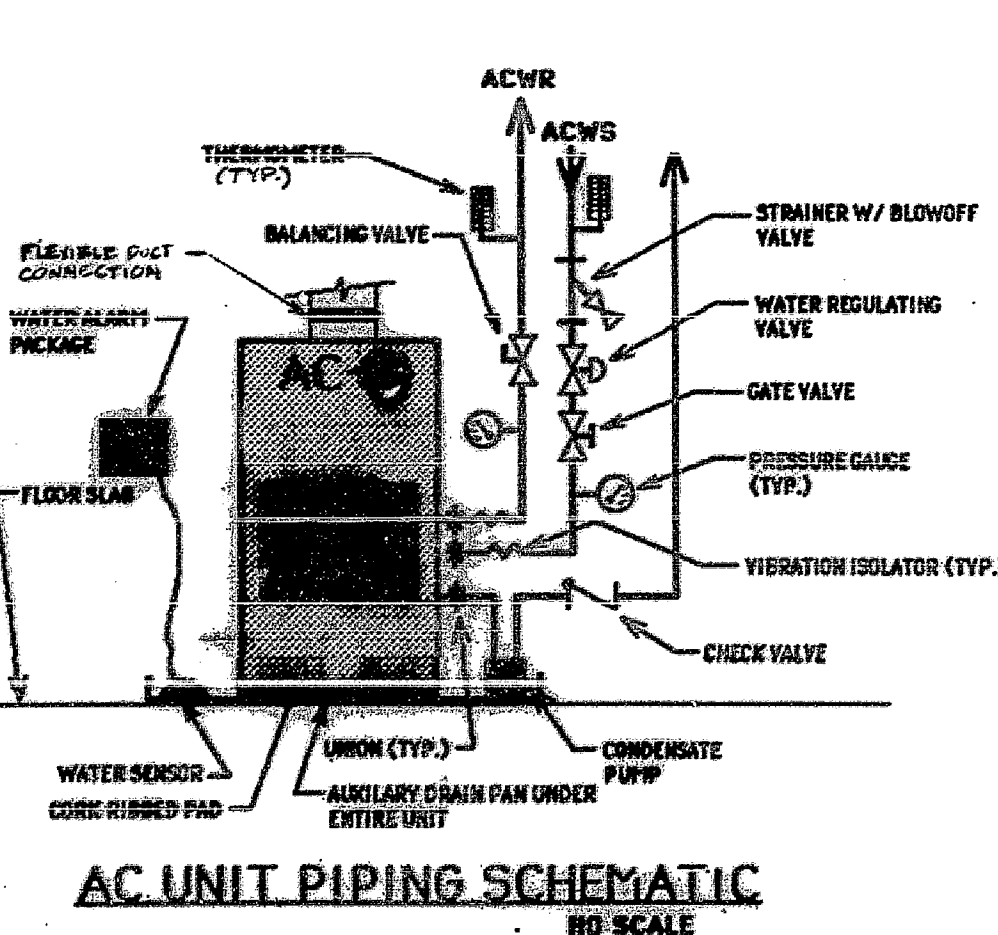

JOHN C. WESTRICK & ASSOCIATES
CONSULTING ENGINEERS
2110 MAPLE AVE. SOUTH PLAINFIELD, N.J. 07080
908 561-4170

DATE	ISSUED TO	PR	TR
4/28/92	POST AUTHORITY FOR APPROVAL	12	-
4/28/92	C.F.E.C.	2	-
5-10-92	POST AUTHORITY FOR APPROVAL	12	-
5-22-92	POST AUTHORITY FOR APPROVAL	12	-

NO.	DATE	REVISION	BY
2	5-24-92	REVISED PER P.A. COMMENTS	P.E.
1	6-8-92	REVISED PER P.A. COMMENTS	J.W.

CANTOR, FITZGERALD SECURITIES CORP.
105TH FLOOR
ONE WORLD TRADECENTER, NEW YORK, N.Y.

PROPOSED ALTERATION TO C.B. TRADING ROOM MECHANICAL PLAN & DETAILS

PROJECT NO. 92119
SCALE AS SHOWN
DRAWN BY FE
CHECKED BY JCW
DATE 4/27/92

DRAWING NO. **105R-M2**